

Ullfrotte® 70% Wool/ 12% Aramid/ 18% Polyimide


400 g/m² , Navy

Testing Performed by Hugh Hoagland

The following tests were performed on flat panels spaced 12 inches from the arc and an electrode spacing of 12 inches with an average current of 8 kA and durations of 14.2 to 18.2 cycles. The tests were done at Ontario Hydro's High Current Lab in Toronto, Canada on June 23, 1999. These tests were conducted in accordance with ASTM 1959.

Fabric Code:

Differential from Stoll Curve vs Incident

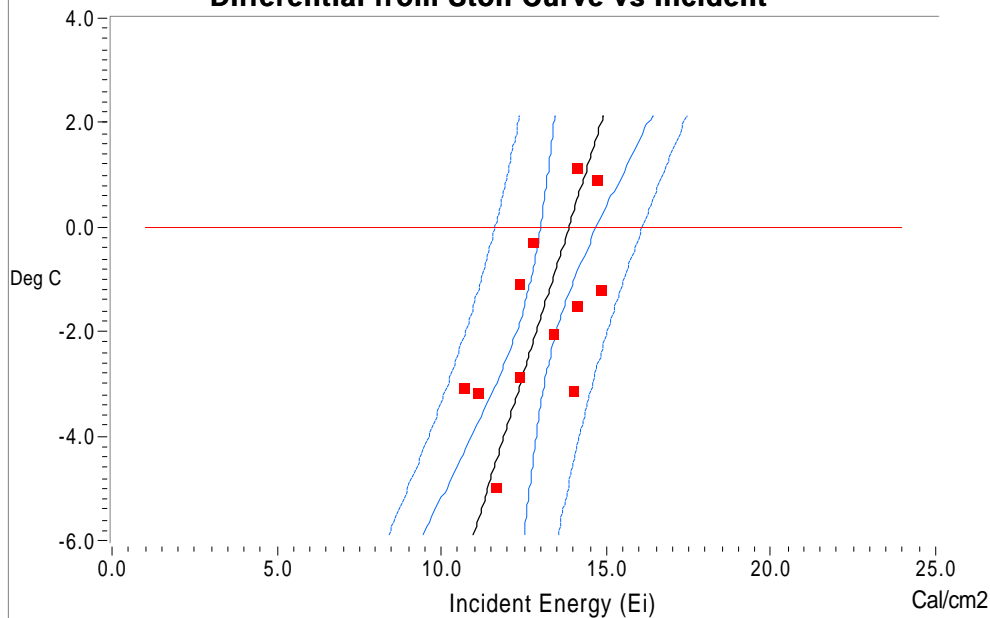

of points

12

% Above Stoll

16.7

Average of Highest


5 Points

Below Stoll

Ebt Value

13.80

Heat Attenuation Factor vs Incident Energy

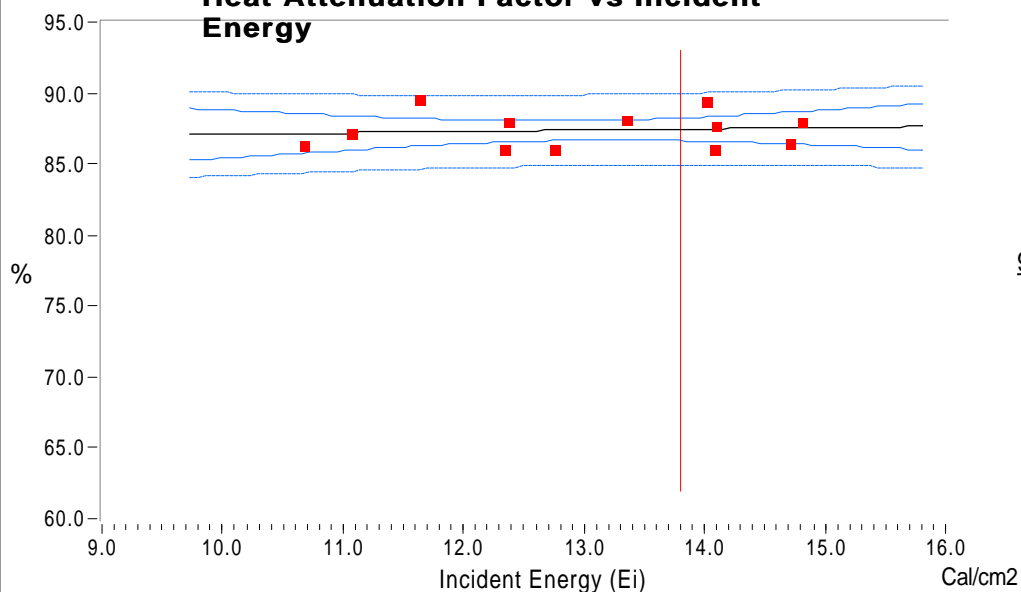

HAF at Ebt

87.4

95% CI for HAF

86.6 , 88.2

95% CI for Data Pts

84.9 , 90.0